


# MicroRex analogue time switches

for rail

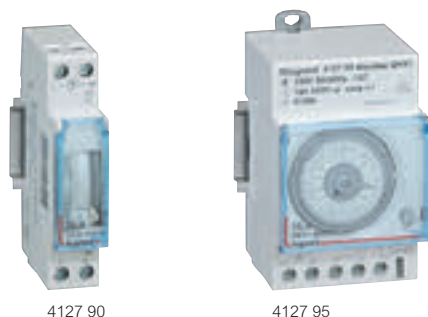

4127 90

4127 95

Conform to EN 60730-1 and EN 60730-2-7  
 Programmed via captive segment  
 Supply voltage : 230 V~ 50/60 Hz  
 1 x 16 A output  
 Manual changeover to summer/winter time  
 Mount on DIN rail EN 60715

Pack	Cat. Nos.	Daily programme
1	4127 80	24 hour programme One segment : 15 minutes Switching accuracy : ± 5 minutes <b>T11 Daily</b> 1 channel Without working reserve N/O contact Minimum switching time : 15 minutes Vertical dial
1	4127 90	<b>QT11 Daily</b> 1 channel With 100 hr working reserve N/O contact Minimum switching time : 15 minutes Vertical dial
1	4128 12	<b>T31 Daily</b> 1 channel Without working reserve Changeover switch Minimum switching time : 30 minutes Horizontal dial
1	4128 13	<b>QT31 Daily</b> 1 channel With 100 hr working reserve Changeover switch Minimum switching time : 30 minutes Horizontal dial
<b>Weekly programme</b>		
1	4127 94	7 day programme One segment : 2 hours Switching accuracy : ± 30 minutes <b>QW11 Weekly</b> With 100 hr working reserve N/O contact Minimum switching time : 2 hours Vertical dial
1	4127 95	<b>QW31 Weekly</b> With 100 hr working reserve Changeover switch Minimum switching time : 4 hours Horizontal dial

No. of 17.5 mm modules  
1

1

3

3

No. of 17.5 mm modules  
1

3


## Technical information

Cat. Nos.	Programme	Segment	Min. switching time	Working reserve	16 A output via contact		No. of modules
					N/O	Chang. S.	
4128 12	24 h	15 min	30 min	without	-	1	3
4128 13	24 h	15 min	30 min	100 h	-	1	3
4127 80	24 h	15 min	15 min	without	1	-	1
4127 90	24 h	15 min	15 min	100 h	1	-	1
4127 94	7 d	2 h	2 h	100 h	1	-	1
4127 95	7 d	2 h	4 h	100 h	-	1	3

## Wiring diagrams

Cat. Nos. 4127 80/90/94

Cat. Nos. 4128 12/13/4127 95

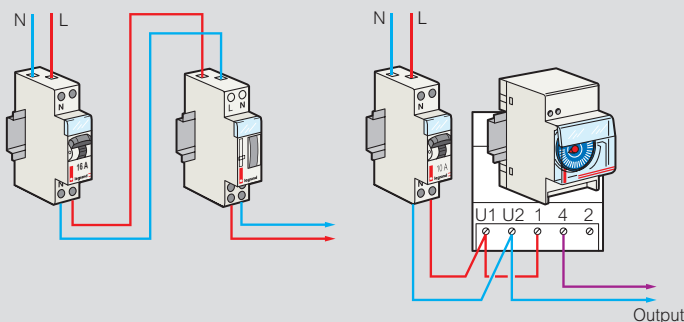

Output closing and breaking times are calculated based on the date, the actual time when the device was switched and on geographical coordinates of the actual location

## Dimensions (mm)

Cat. Nos. 4127 80/90/94

Cat. Nos. 4128 12/13/4127 95

